



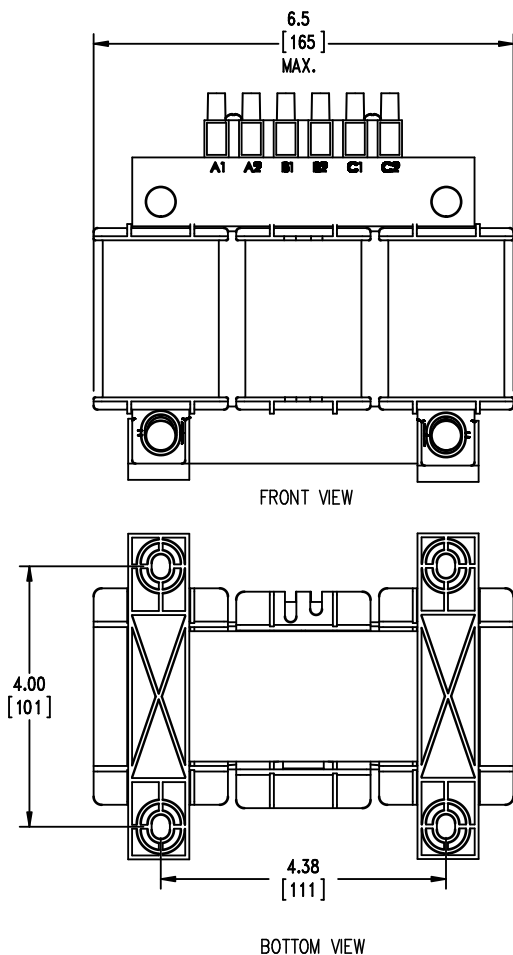


FRONT VIEW

BOTTOM VIEW

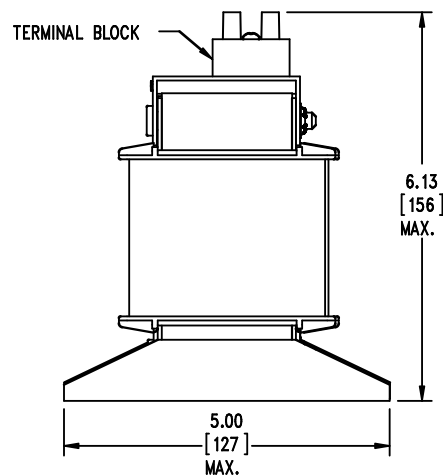

SIDE VIEW

TERMINAL BLOCK
SUITABLE FOR
#13 TO #10 AWG
CONDUCTORS
QTY. 1 PER PHASE



MTG SLOT DETAIL



TOLERANCES
MOUNTING CENTERS = $\pm .06"$
MOUNTING HOLE SIZE = $\pm .005"$

THIS DRAWING CONTAINS PROPRIETARY INFORMATION
BELONGING TO HAMMOND POWER SOLUTIONS INC.,
AND IS NOT FOR GENERAL DISTRIBUTION

All Dimensions in Inches
mm in Parenthesis

REACTOR



HPS CENTURION R
THREE PHASE DRY TYPE REACTOR
Hammond Power Solutions Inc. CRX0022AC
1.3MH50/60 HZ 22AMPS

0.6 KV CLASS TEMP CLASS: 130 TYPE JR-1
TERMINAL TORQUE: 11 LB-IN AMBIENT: 50°C


f003781e



LR 3902



E61431



IP00

NOTES:



Hammond Power Solutions Inc.

TITLE: 3 PHASE LINE REACTOR

DES: PBAKER
DATE: 14/06/25
SCALE: NTS
NO. DATE BY REVISION

SHEET 1 OF 1

EDBCRX0022AC

0.2 wong 2014/10/23 10:54