


CURRENT IN AMPERES

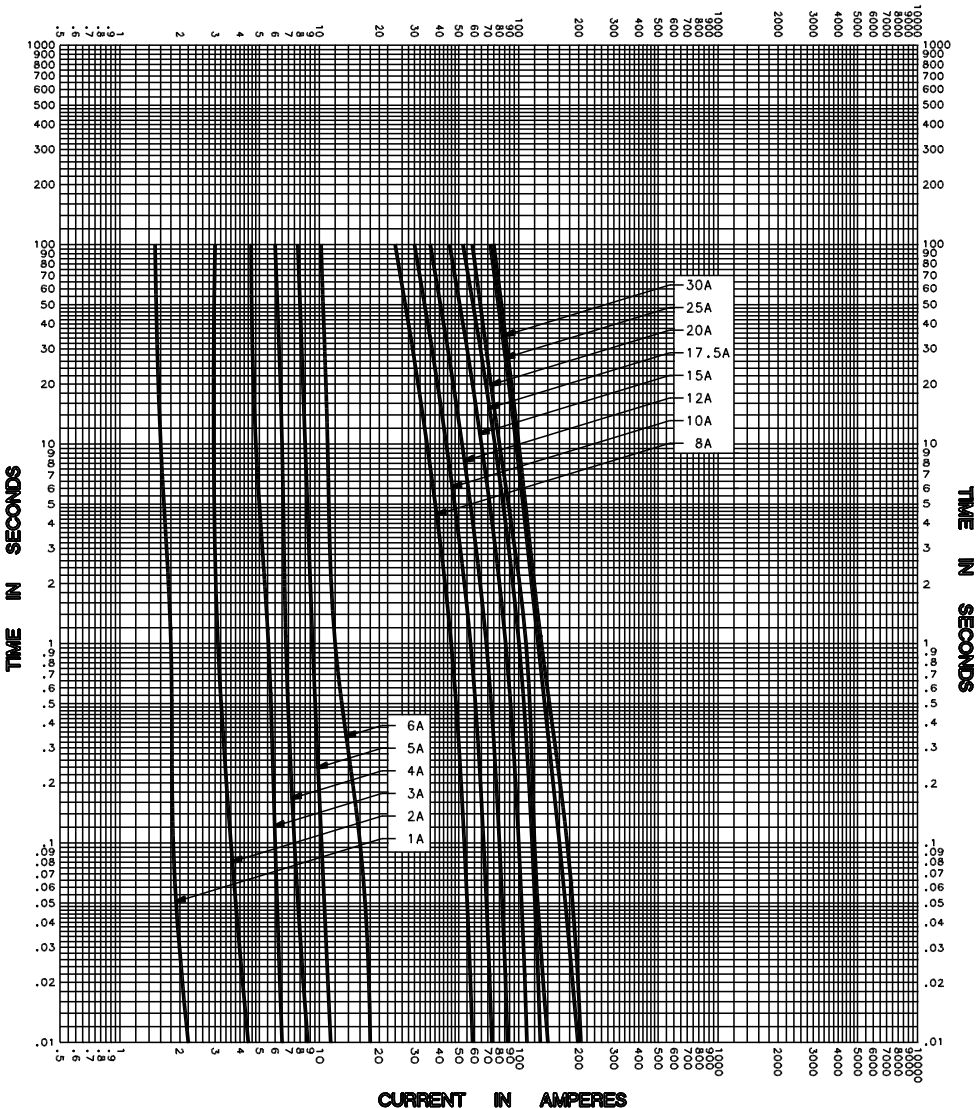

CURRENT IN AMPERES


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	L60S (1A - 30A)

 DES PLAINES, ILLINOIS 60016	DRAWN BY BJJ
	DATE 3/14/02
	CHECKED BY _____
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. B - FCC01-0001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

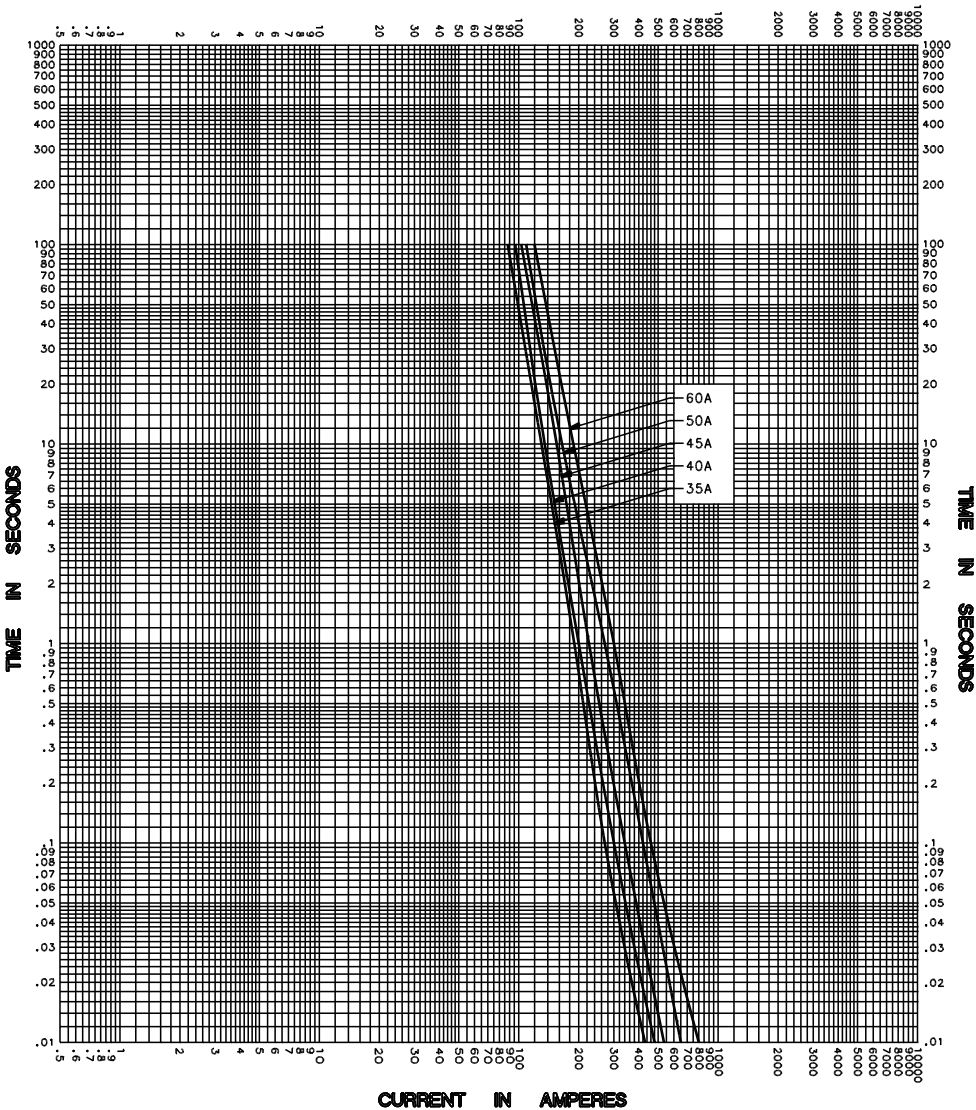


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (35A - 60A)
BASIS FOR DATA _____		

 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 08/16/04
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY MP
	DRAWING NO. A FCC01 08/16/04

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

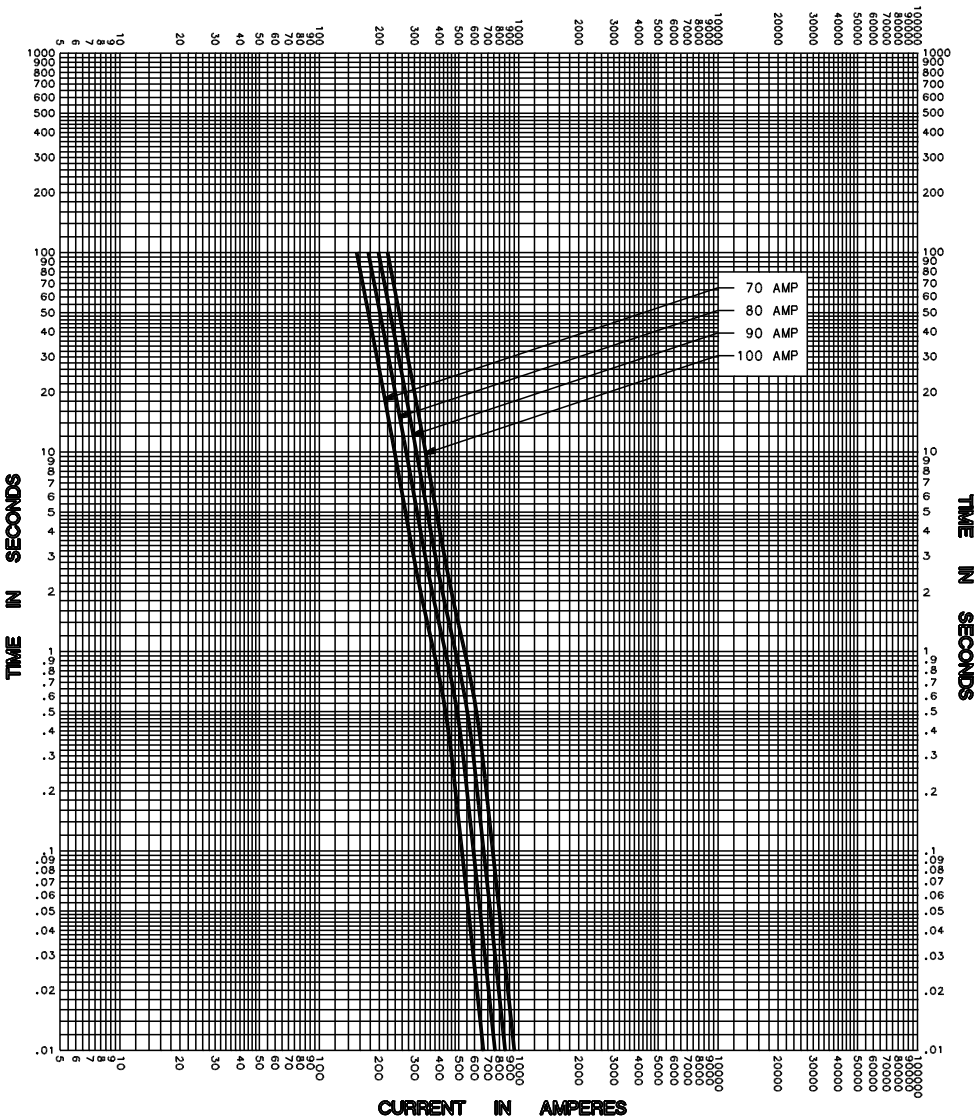


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (70A - 100A)
BASIS FOR DATA _____		

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY MRD
	DATE 02/19/03
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY TN
	DRAWING NO. B-FCC003

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

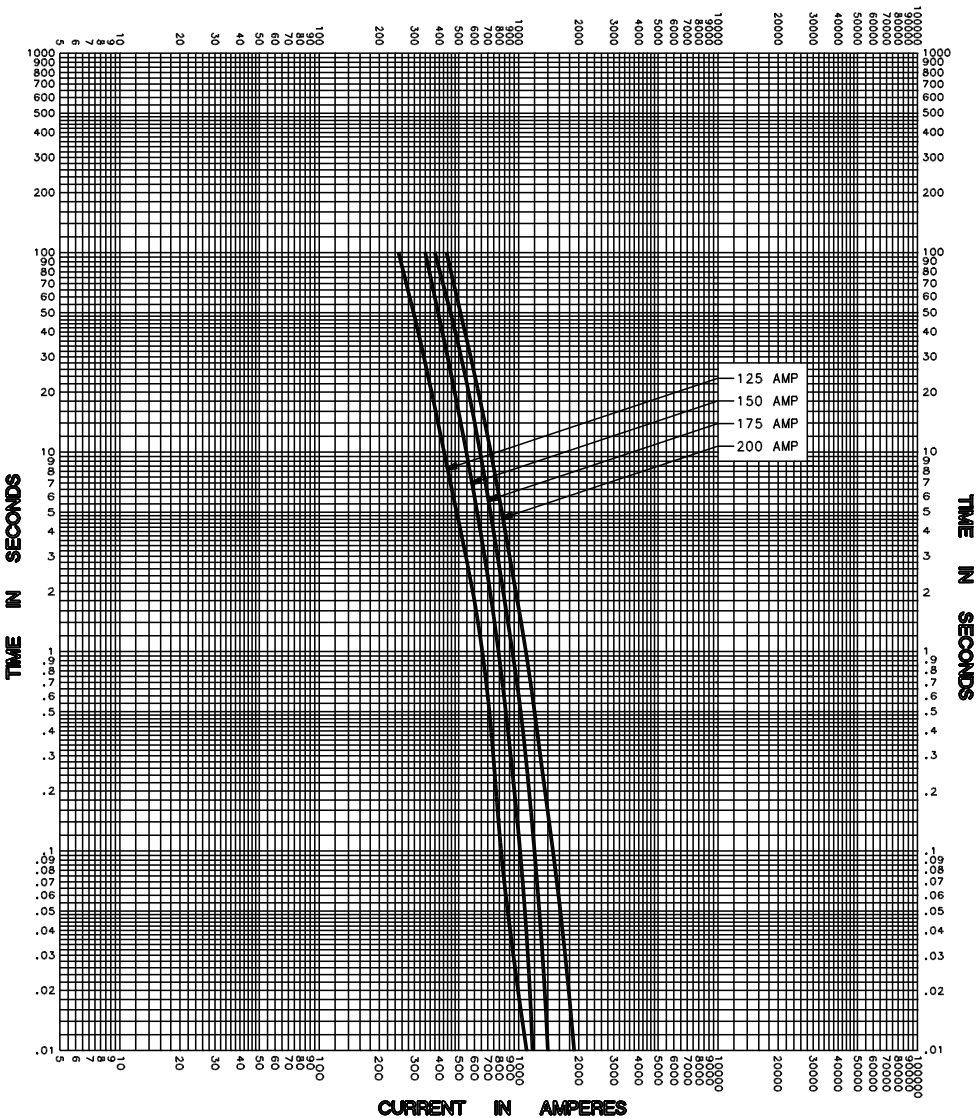

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
L60S (125A - 200A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 08/16/04

CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC004

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

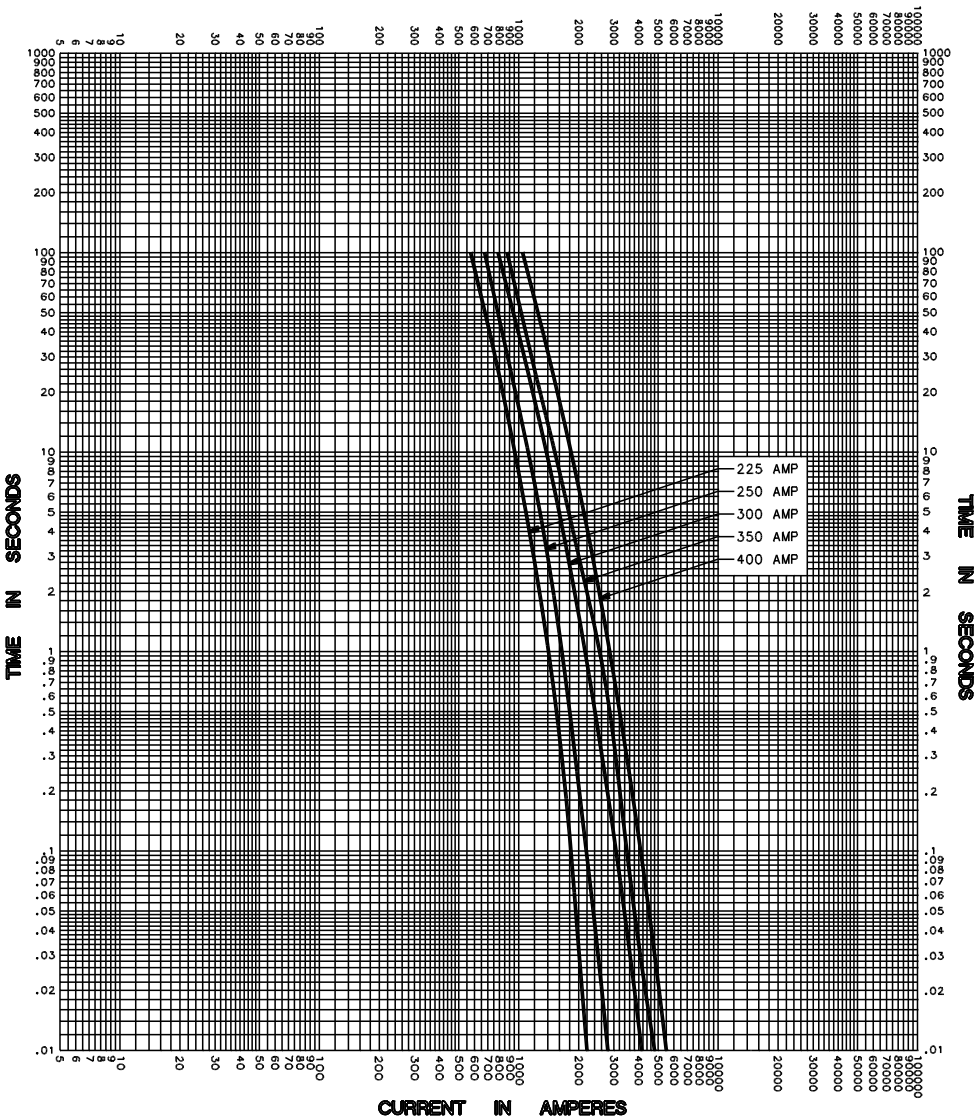

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
L60S (225A - 400A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL

DATE 08/16/04

CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC005

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

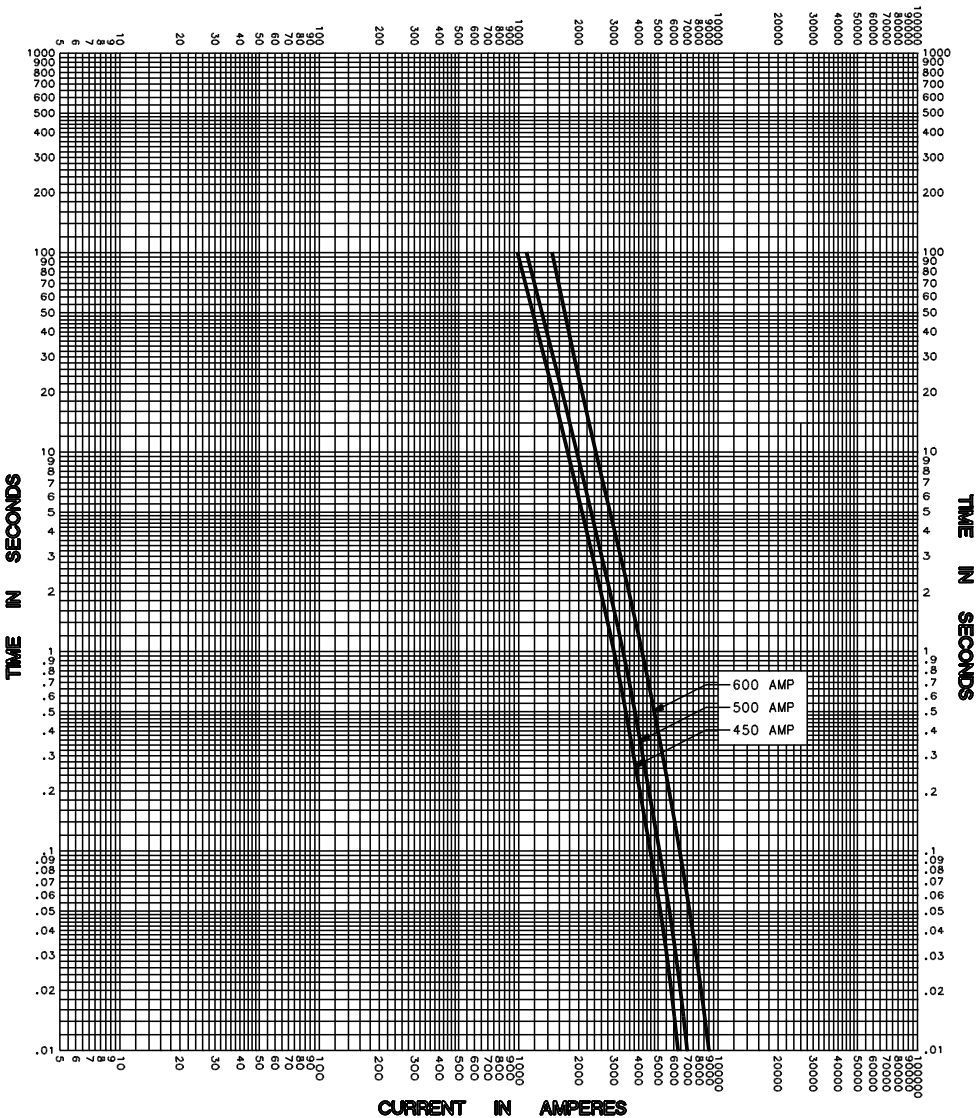


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____		FUSE CATALOG NUMBER
BASIS FOR DATA _____		L60S (450A - 600A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u>
		DATE <u>08/16/04</u>
TIME CURRENT CHARACTERISTIC CURVES		CHECKED BY <u>MP</u>
		DRAWING NO. <u>A-FCC006</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

CURRENT IN AMPERES

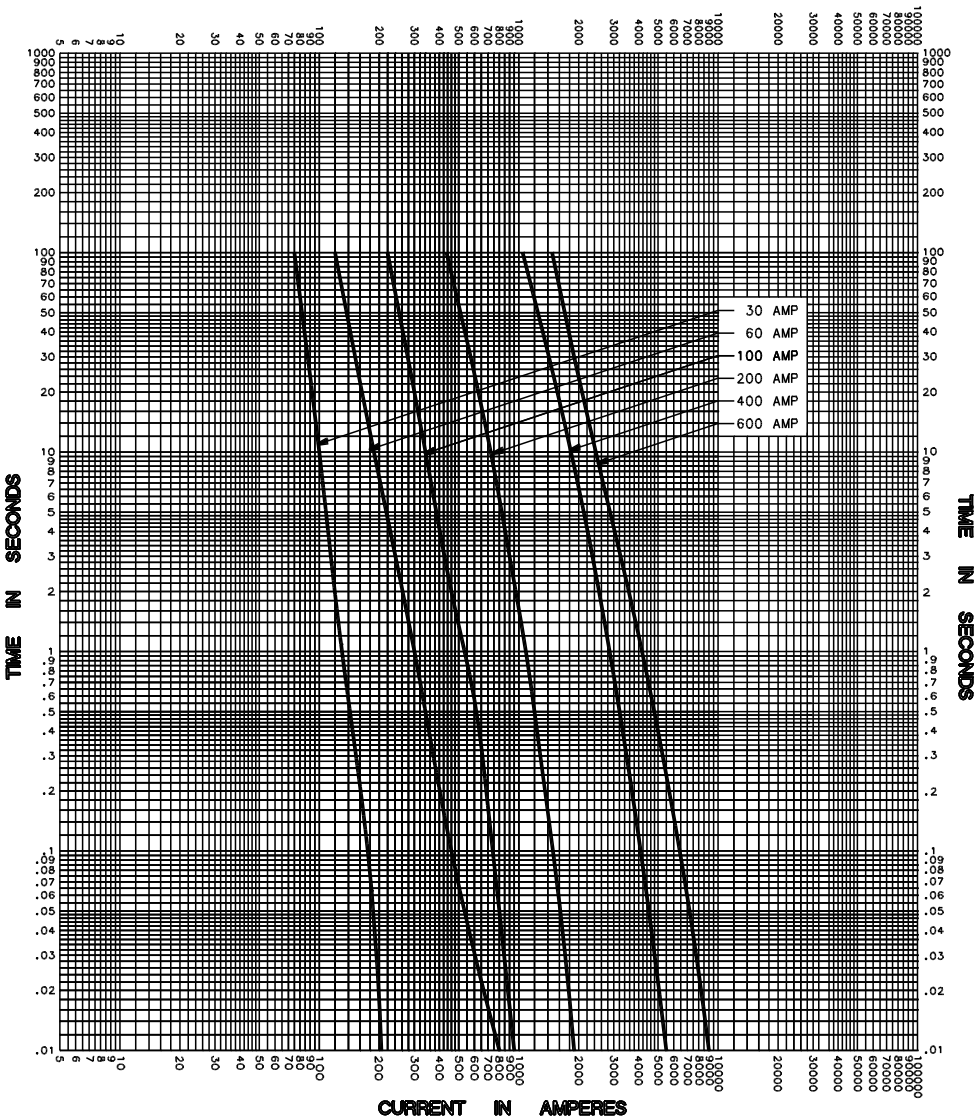

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (30A - 600A)
BASIS FOR DATA _____		



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 08/16/04
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC008

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT